

Location: _____




MI-200

**ELECTRONIC TRAP SEAL
PRIMER WITH AIR GAP**

Specification: MIFAB® Series MI-200, electronic trap seal primer system with copper air gap, plastic manifold with distribution ports, electrical brass body 1/2" stainless steel solenoid valve and 24" wiring harness. Electrical components to include single point power connection at 120 VAC or 24 VDC. The entire assembly is tested and certified to the ASSE 1044 Standard. 100 p.s.i. operating pressure.

Function: The MI-200 is engineered to connect to the low-voltage building energy management system used to control the services in commercial, educational and institutional buildings. It can be located anywhere in the water supply. The MI-200 is practical for infrequently used buildings such as convention centers and sports facilities. It is manufactured in accordance to the ANSI/ASME A112.1.2 air gap in plumbing systems Standard. The UA 12" x 12" access door is suggested for access to the MI-200 when installed into the wall.

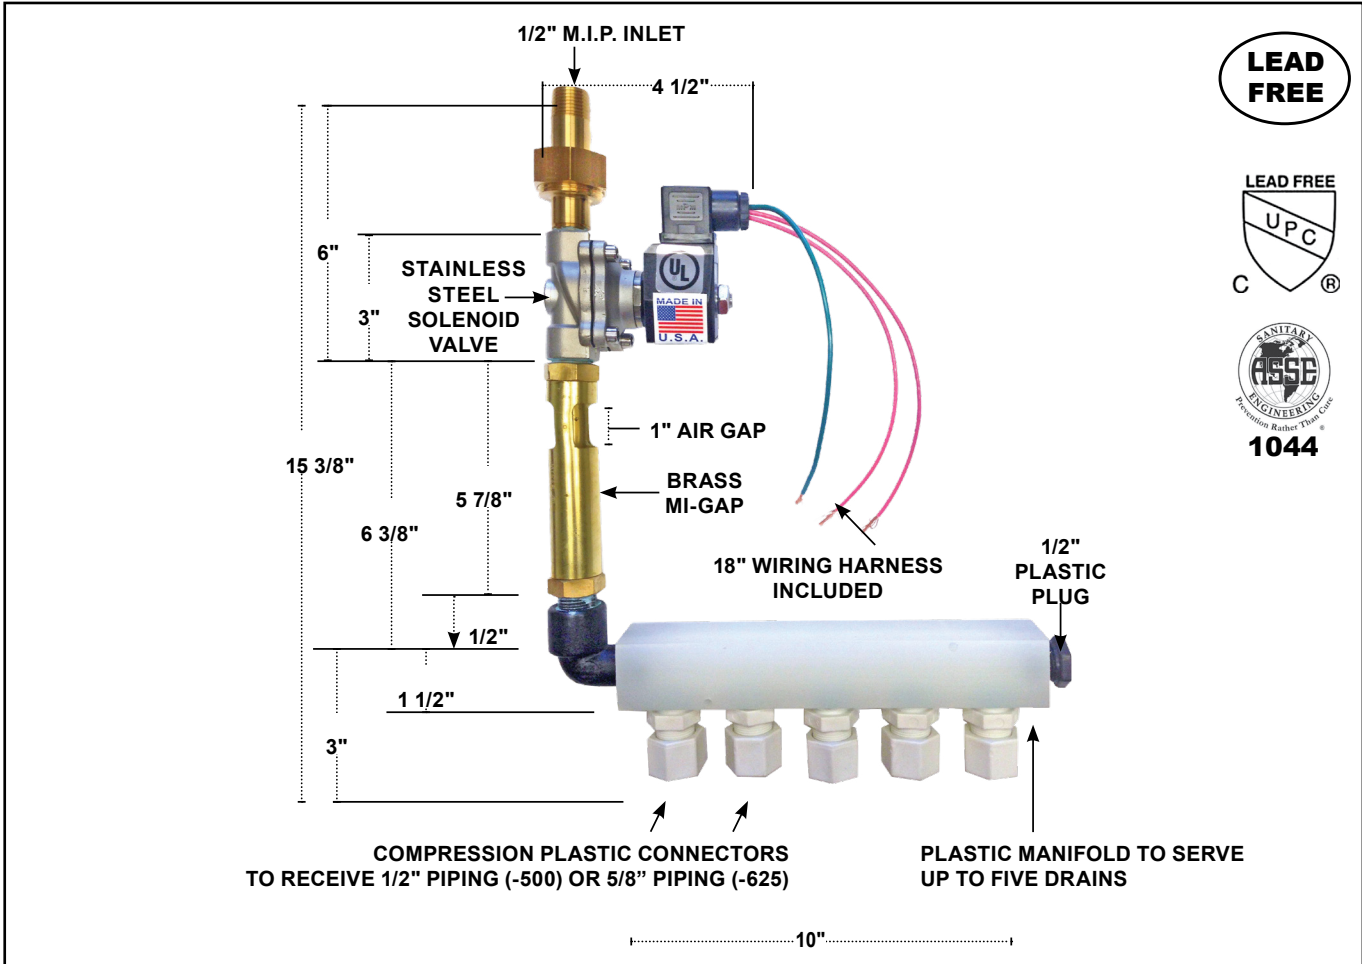

MODEL NO.	DESCRIPTION
MI-200-24-VDC	24 volt VDC
MI-200-120-VAC	120 volt VAC
MI-200-220-VAC	220 volt VAC

SUFFIX	OPTIONAL VARIATIONS
-AD	16 gauge powder epoxy coated steel (white) cabinet cover (bolted to cabinet frame)
-ADSS	Fabricated Stainless Steel (Type 304) cabinet cover (bolted to Stainless Steel cabinet frame)
-BA	Buy American Act compliant product
-BP	Battery Pack Power Source. Specify 24 volt VDC, 120 volt VAC or 220 volt VAC
-ENC	16 gauge powder epoxy coated steel (white) cabinet to enclose
-ENCSS	16 gauge fabricated Stainless Steel (Type 304) cabinet to enclose MI-200
-PA	Pennsylvania Steel Act compliant product
-500	1/2" compression connection
-625	5/8" compression connection

CALIFORNIA PROPOSITION 65 WARNING. This product contains chemicals known to the State of California to cause cancer and birth defects or other reproductive harm.

Job Name: _____ Page No: _____
 Section No: _____ Contractor: _____
 Schedule No: _____ Purchase Order No: _____

Location: _____



MI-200

**ELECTRONIC TRAP SEAL
PRIMER WITH AIR GAP**

TRAP SEAL PRIMER TROUBLESHOOTING

Following are some things to trouble shoot when it comes to our M-500 Series of Trap Seal Primers (M1-500, M2-500, M-500).

1) What is the line pressure for the Installation?

The M-500 Series will work in 35-80psi.

2) How far away is the trap seal primer from the source of the pressure drop?

Anything farther away than 20 feet is an issue, as the farther the primer is away from the source of the pressure drop, the less likely it will sense it and work.

3) What is the pressure drop where the primer is?

MIFAB's M-500 Series of primers will work with as little as 3 psi in pressure drop. With today's low flow and consumption faucets, there is less pressure drop being created when the faucets and toilets are used.

4) Water hammer arrestors on the line can also affect pressure drop in the line.

It would be best to get a pressure reading where the trap primer is installed. The M-500 series needs a fast, sharp pressure drop to activate. The long pipe run to the trap primer and the water hammer arrestor may not be allowing the trap primer to function properly.

5) Look at the gauge fluctuation

Is it a quick and sharp pressure drop? Or did it gradually drop? The trap primers need a quick pressure drop to activate. A slow gradual pressure drop may not be enough to activate the M-500. That is why we state that they should be as close to the pressure drop source as possible. The M1-500 has the most buoyant cartridge and should perform the best. If the trap primer looked good and was filled with water then it is the rate of the pressure drop that is causing the issue.

Also refer to the copy in the Trap Seal Primer section in the MPB-2015-USA List Price book.

CALIFORNIA PROPOSITION 65 WARNING. This product contains chemicals known to the State of California to cause cancer and birth defects or other reproductive harm.

Job Name: _____ Page No: _____
Section No: _____ Contractor: _____
Schedule No: _____ Purchase Order No: _____