


Specification: MIFAB® Series MI-G (CAN) _____ sanitary powder epoxy coated inside and outside fabricated 10 gauge steel grease interceptor with flow rating of _____ (indicate) and grease holding capacity of _____ (indicate). Unit shall include: removable baffle assembly and cross bar, deep seal trap covered by lid, securing bolt(s), calibrated stainless steel orifice plate, (flow control) internal air relief by pass and steel powder epoxy coated, non skid, rectangular gasketed lid(s).

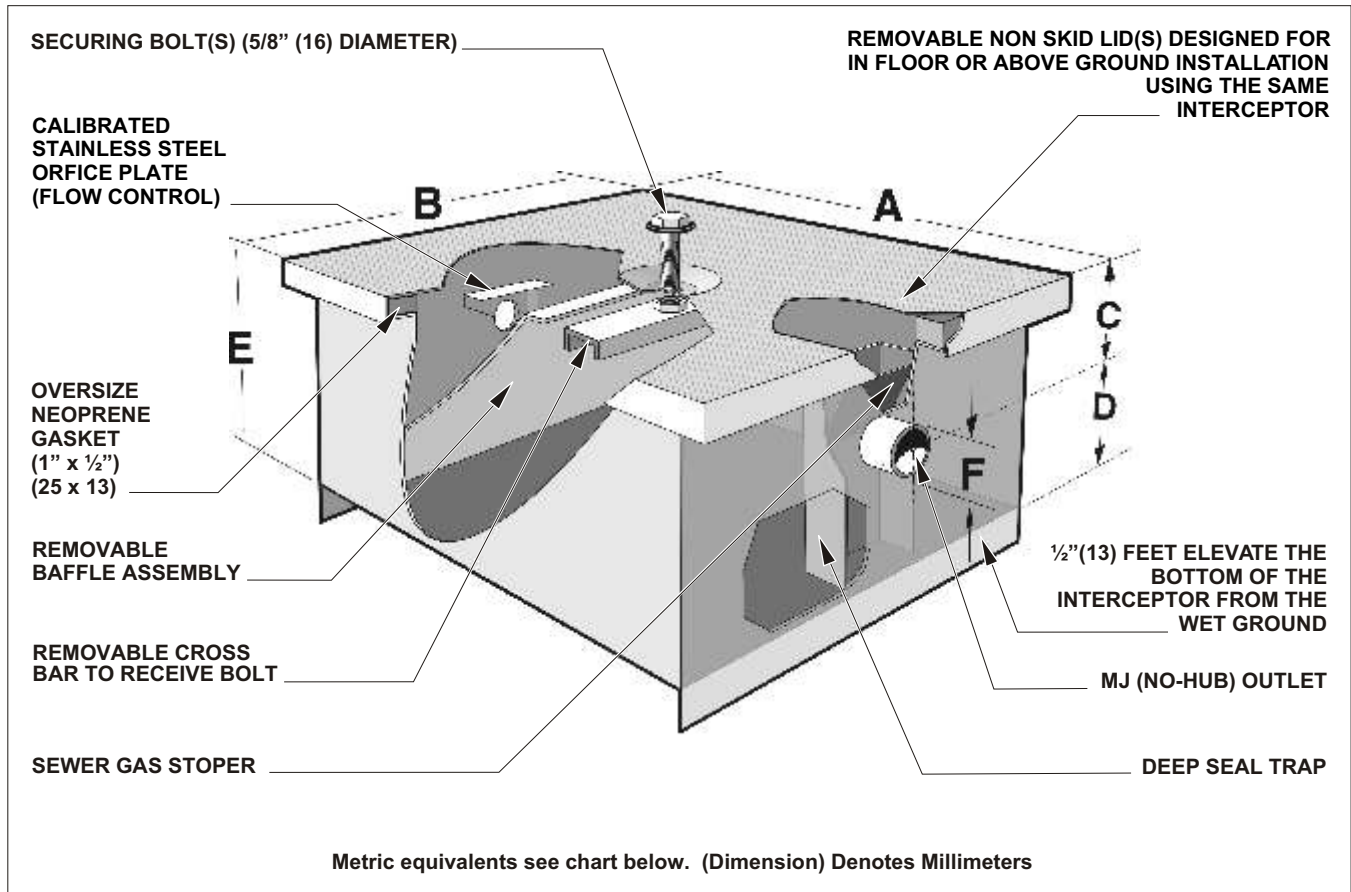

Note: The "C" dimension detailed above is from either the middle of the inlet or outlet to the top of the interceptor. The inlet and outlet dimensions are always the same.

MODEL NO.	US GPM	CAP. LBS.	A	B	C	D	E	F	NO. OF LIDS	NO. OF BOLTS
MI-G-O	4	8	16.75" (419)	11.25" (281)	2.5" (63)	8.5" (213)	11" (275)	2" (50)	1	1
MI-G-1	7	14	17.75" (444)	13.75" (344)	3.5" (88)	8.5" (213)	12" (300)	2" (50)	1	1
MI-G-2	10	20	21.25" (531)	15.75" (394)	3.5" (88)	9.5" (238)	13" (325)	2" (50)	1	1
MI-G-3	15	30	23.75" (594)	15.75" (394)	3.5" (88)	11.5" (288)	15" (375)	2" (50)	1	1
MI-G-4	20	40	23.75" (594)	15.75" (394)	3.5" (88)	14.0" (350)	17.5" (444)	3" (75)	1	1
MI-G-5	25	50	27.75" (694)	18.75" (469)	3.5" (88)	14.0" (350)	17.5" (444)	3" (75)	1	1
MI-G-6	35	70	31.25" (781)	23.25" (594)	5.5" (138)	16.5" (413)	22" (550)	3" (75)	2	4
MI-G-7	50	100	31.25" (781)	23.25" (594)	5.5" (138)	18.5" (463)	24" (600)	3" (75)	2	4

Note: Reduce the "A" and "B" dimensions by 1" (25) to determine the actual body length and with dimensions. The lid overhangs the body by 1/2" (13) on all four sides.

OPTIONAL VARIATIONS:

- | | | | | | |
|--|----------------------|---|----------------------|--|----------------------|
| <input type="checkbox"/> Aluminum lid(s) | SUFFIX
-AL | <input type="checkbox"/> Anchor flange | SUFFIX
-FL | <input type="checkbox"/> Sediment bucket | SUFFIX
-SB |
| <input type="checkbox"/> Anode pack | -AP | <input type="checkbox"/> Anchor flange and membrane clamp | -FLM | <input type="checkbox"/> Stainless steel interceptor | -SS |
| <input type="checkbox"/> Extension "C" as required | -C | <input type="checkbox"/> Heavy duty reinforced lid(s) | -HD | <input type="checkbox"/> I.P.S. female threaded inlet and outlet | T |
| <input type="checkbox"/> Dual inlets | -DI | | | <input type="checkbox"/> Lid(s) to receive tile or terrazzo | -TL |
| <input type="checkbox"/> Special size inlet and outlet specify | | | | | |

Job Name: _____	Page No: _____
Section No: _____	Contractor: _____
Schedule No: _____	Purchase Order No: _____